


Through-penetration Firestop Systems

System No. W-J-1286

ANSI/UL1479 (ASTM E814)	CAN / ULC S115
F Rating — 3 Hr	F Rating – 3 Hr
T Rating — 0 Hr	FT Rating – 0 Hr
	FH Rating – 3 Hr
	FTH Rating – 0 Hr

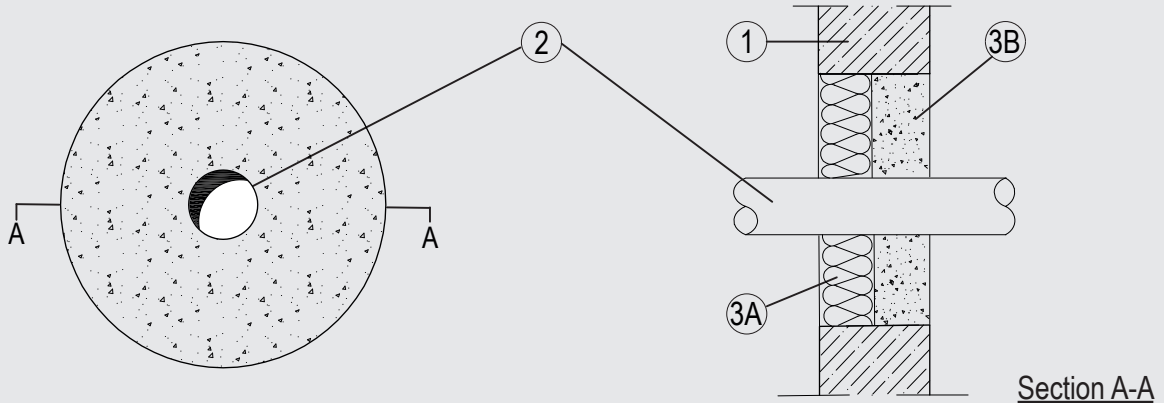

1. Wall Assembly

Min. 4-1/2 in. (115 mm) thick lightweight or normal weight (100-150 pcf or 1600 - 2400 kg/m³) concrete. Wall may also be constructed of any UL Classified Concrete Blocks*. Opening shall be rectangular or circular with max dimensions of 5-1/4 in. (132 mm). See Concrete Blocks (CAZT) in the Fire Resistance Directory for names of manufacturers.

2. Pipes/ Tubes

Single to be installed within the opening. The annular space between the pipes and the periphery of the opening to be 2 in (50 mm). Pipes to be rigidly supported on both sides of the wall assembly. The following penetrants may be used:

- A. Max 1-1/4 in. (32 mm) diameter Schedule M (or heavier) copper pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
- B. Max 1-1/4 in. (32 mm) diameter Schedule 5 (or heavier) steel pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

3. Through-Penetration Firestop System

The Through-Penetration Firestop System shall consist of the following:

- A. Packing material — Nom. 2-3/8 in. (60 mm) thick mineral wool board min. 9.3 pcf (150 kg/m³), firmly packed into the opening of the wall as a permanent form flush to one face of the wall.
- B. Fill, Void or Cavity Material* — Mortar - Nom 2-1/8 in. (55 mm) cast in to aperture in the wall flush to one face of the wall and around the services.

SVT BRANDSCHUTZ VERTRIEBSGESELLSCHAFT MBH INTERNATIONAL — PYRO-SAFE NOVASIT VGM

*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Please contact us for further information:

✉ Information: global@svt.de Order: order@svt.de
 ☎ +49 4105-40 90-0